


Name pr:PAV-HV2.F	Package	GP02
	Execution	1000 ms
	Order	20




0

pr:PAV-SS
Start/Stop-nappi



:bv



bin -> BOOL	
Name	
pr:PAV-HV2.0	
Profibus I/O	4 : 2 : 0.1
:c	Control
:cb	Feedback
Venttiilin HV-2 ohjaus	



Planner	08-03-20 08:23	c1303
Modification	08-04-03 12:53	c1303

Customer


Department JAMK
IST5SA
PAVA

Tag
PAV-HV2

Loop name

Page 1 / 1

Name	Package	GP02
pr:PAV-LS1.F	Execution	1000 ms
	Order	20



BYTE -> bin8	
Name	
pr:PAV-LS1.I	
Profibus I/O	4 : 2 : 4
Measurement	:m



Planner
08-03-20 11:01

c1303

Modification
08-04-03 12:54


c1303


Customer

Department JAMK
IST5SA
PAVA



Tag
PAV-LS1

Loop name

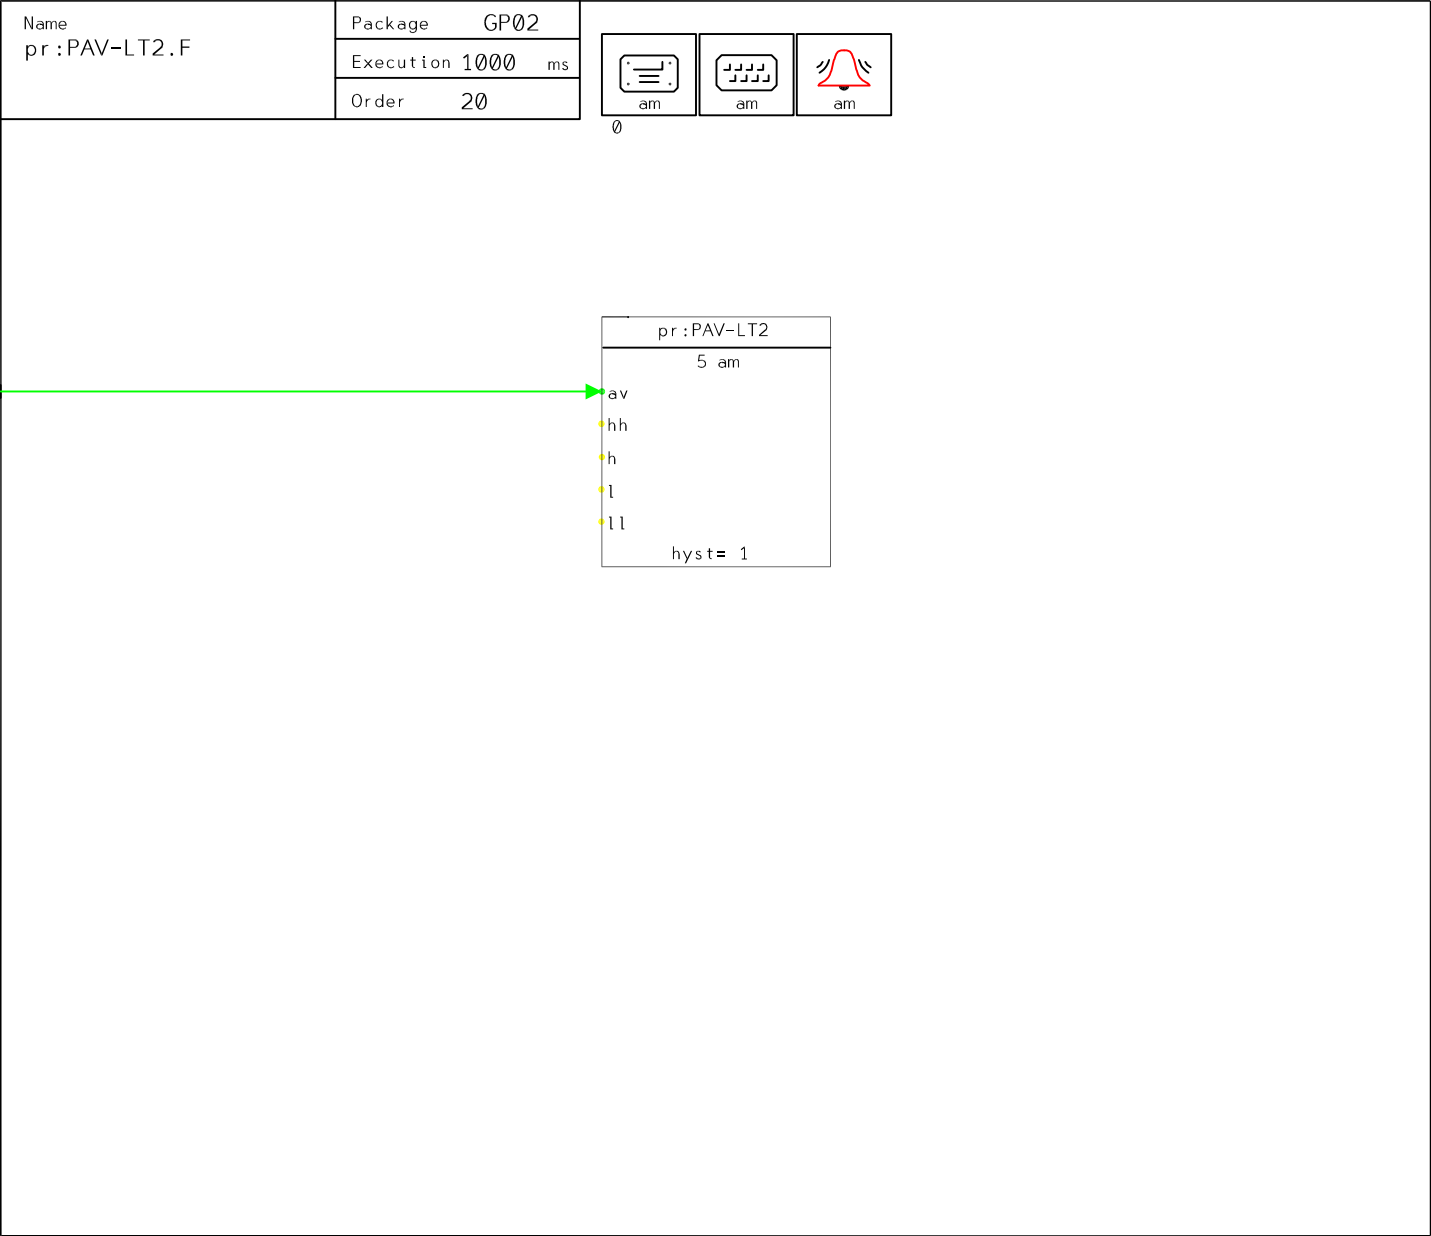

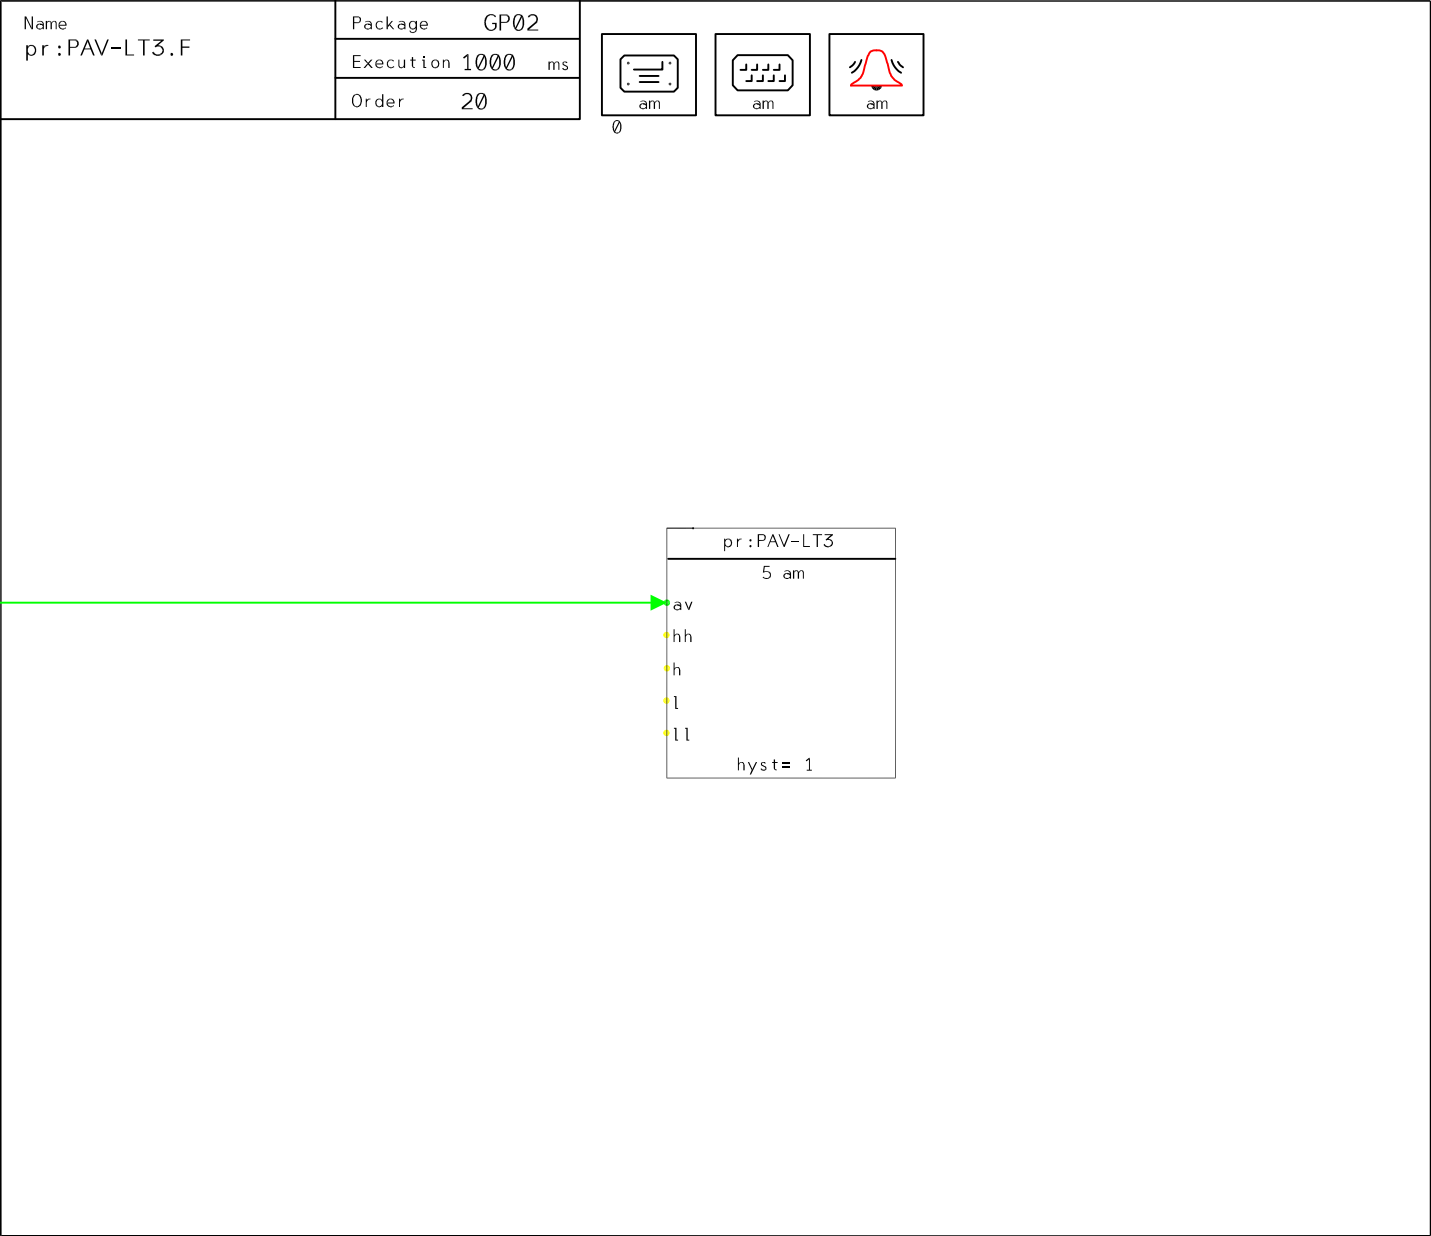


Name	pr:PAV-P1.F
Package	GP02
Execution	1000 ms
Order	20



BOOL -> bin
Name
pr:PAV-P1.I
Profibus I/O 4 : 3 : 8.4
Measurement :m
Läyntitieto TaMu

pr:PAV-SS
Start/Stop-nappi
pr:PAV-LS1.F:out1
Säiliön T3 yläraja

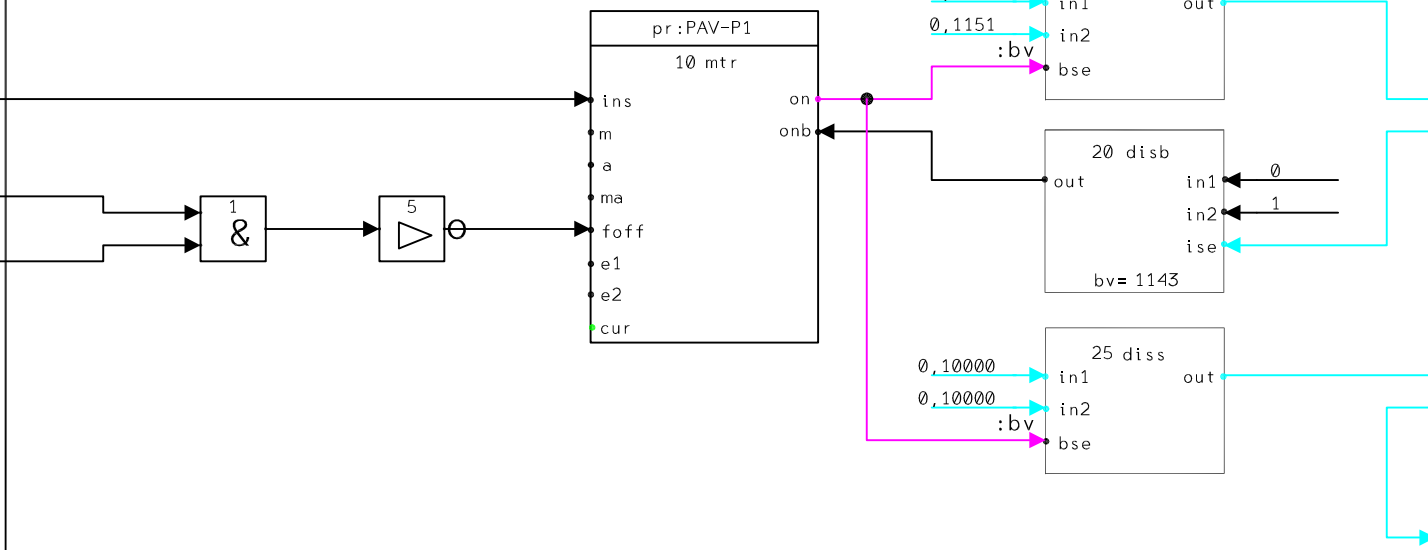

ints -> WORD
Name
pr:PAV-P1.0
Profibus I/O 4 : 3 : 8
:c Control
:cb Feedback
Pumpun P1 ohjaus

ints -> WORD
Name
pr:PAV-P1-REF.0
Profibus I/O 4 : 3 : 10
:c Control
:cb Feedback
Pumpun P1 taajuusasetus



Planner	08-03-20 08:57	c1303
Modification	08-04-03 12:56	c1303

Customer

Department JAMK
IST5SA
PAVA

Tag
PAV-P1

Loop name

Page 1 / 1